


(SEE VALVE AND BOX DETAIL M-5)

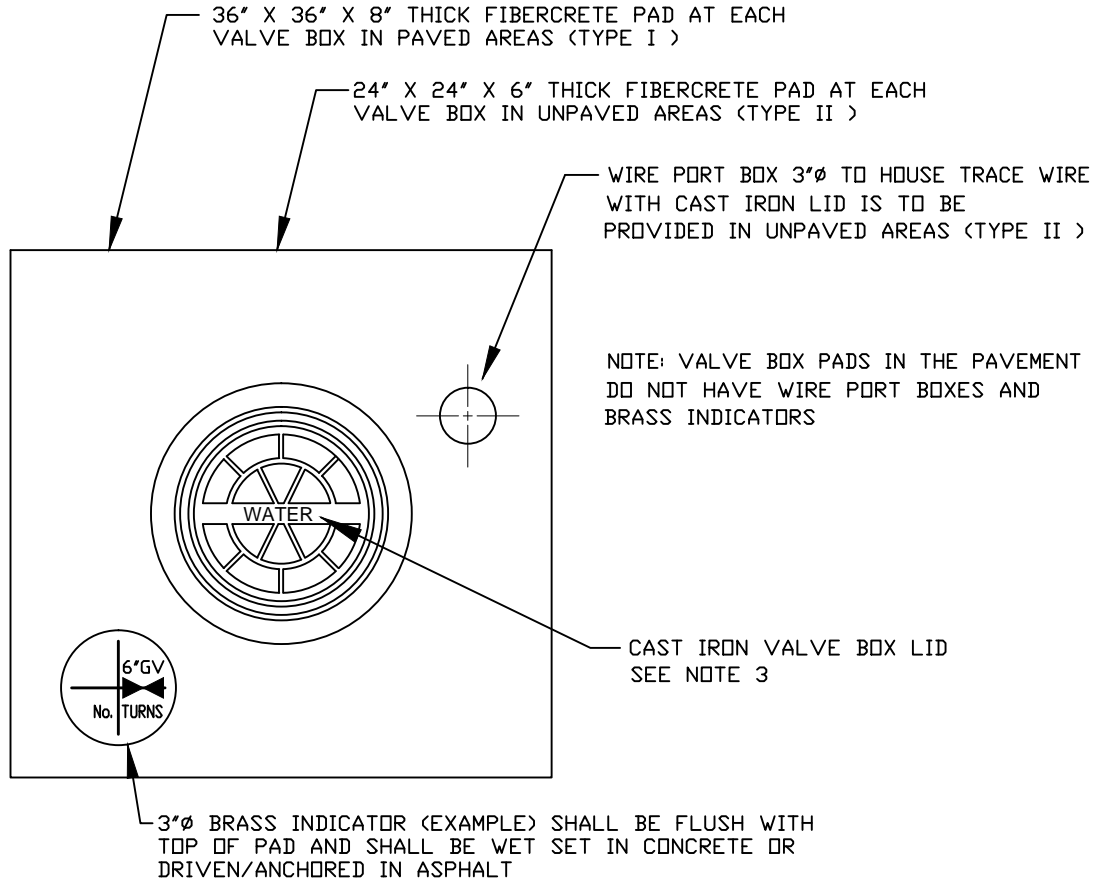

PLAN VIEW

-ART-

NOTES

1. VALVE BOX LIDS SHALL BE PAINTED:  
BLUE - WATER  
RED - FIRE HYDRANTS  
GREEN - FORCE MAINS  
PURPLE - REUSE MAINS  
BROWN - BRINE
2. IN UNPAVED AREAS (SEE M-5, TYPE II) A BRASS VALVE INDICATOR IS TO BE PROVIDED, WITH ENGRAVED DIAGRAM OF VALVE LOCATION AND DESCRIPTION. (SEE EXAMPLE ABOVE) INDICATOR SHALL BE FLUSH WITH VALVE PAD.
3. VALVE BOX LID LOCATED IN PAVEMENT SHALL BE A CAST IRON, STAY-PUT COVER, MINIMUM 24 LBS. WITH A MINIMUM 6" LONG THROAT AND SHALL BE MARKED WITH RAISED LETTERS: "WATER", "SEWER", "BRINE", OR "REUSE WATER" AS APPLICABLE.
4. VALVE BOX SHALL COMPLY WITH FDOT STANDARDS AS APPLICABLE.
5. NO VALVE RINGS ARE TO BE USED.
6. IN TYPE I, PAVED AREAS, THE VALVE BOX PAD TOP ELEVATION SHALL BE EVEN WITH THE ROCK GRADE TO ALLOW BOTH LAYERS OF ASPHALT TO COVER THE VALVE BOX PAD WITH THE FINAL ASPHALT LAYER FLUSH WITH THE TOP OF THE VALVE BOX. (SEE VALVE AND BOX DETAIL M-5)

INDIAN RIVER COUNTY  
DEPARTMENT OF  
UTILITY SERVICES



VALVE BOX PAD

DRAWING  
NO.

M-6

MARCH 2018