


PLAN VIEW  
ALTERNATIVE "A"

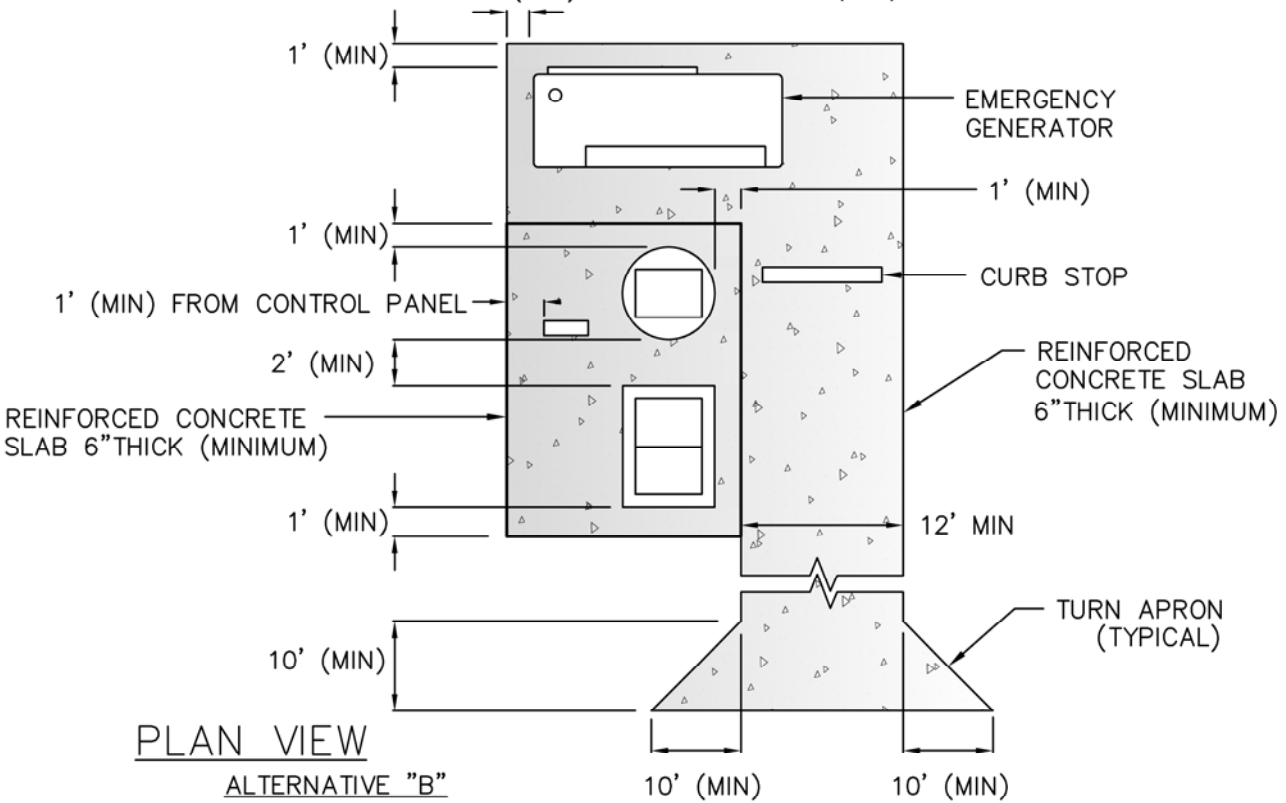

PLAN VIEW  
ALTERNATIVE "B"

-ART-

NOTES

1. LOCATION OF CONTROL PANEL PER IRCUDS INSPECTOR.
2. NATURAL GAS TO BE USED TO POWER GENERATOR IF AVAILABLE.
3. EXPANSION JOINTS SHALL BE REQUIRED AT WETWELL, VALVE PIT AND MANHOLE AS APPLICABLE.
4. CONCRETE SLAB CONSTRUCTION TO CONFORM TO ACI 318 STANDARD.

INDIAN RIVER COUNTY  
DEPARTMENT OF  
UTILITIES SERVICES



TYPICAL PUMPING STATION  
(DETAIL SHEET)

DRAWING NO.  
S-17

MARCH 2014