


IRCDUS ←————— CUSTOMER RESPONSIBILITY —————→ CUSTOMER SHALL BE RESPONSIBLE FOR ALL MAINTENANCE WITH THE EXCEPTION OF THE METER WHICH IS THE PROPERTY OF IRCDUS

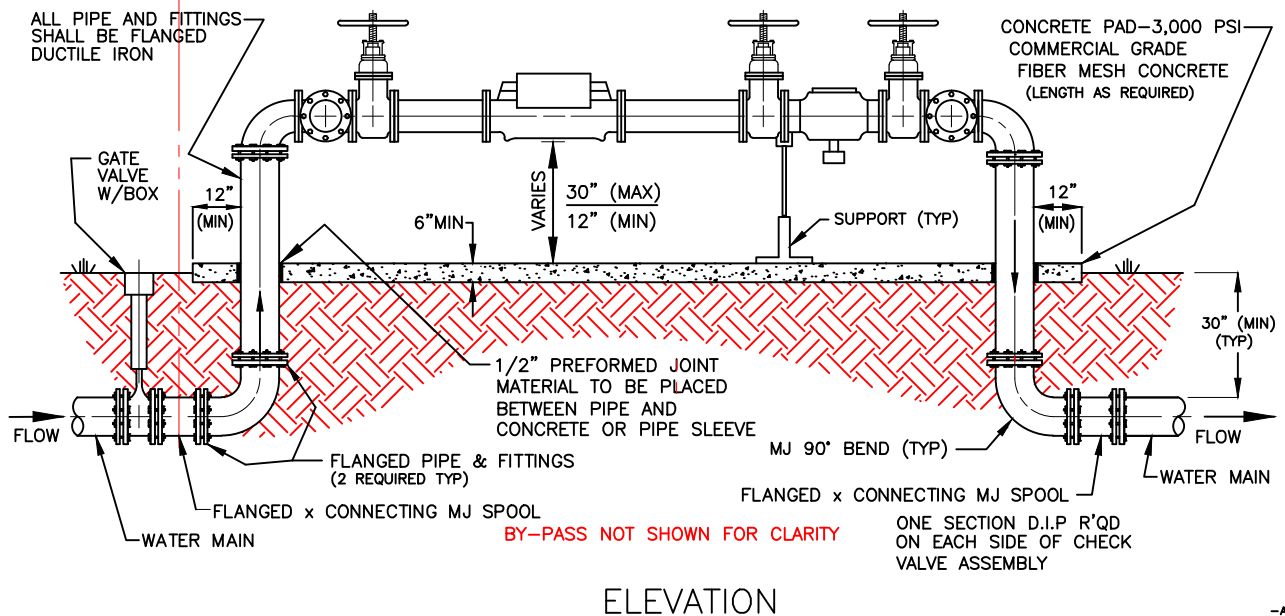

NOTES

1. ALL ABOVE GROUND PIPING SHALL BE FLANGED DUCTILE IRON.
2. FIELD FABRICATED FLANGES MUST BE APPROVED BY IRCDUS ENGINEERING.
3. DEVICE TO BE INSTALLED IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
4. ASSEMBLY TO BE PRIMED WITH RUST INHIBITIVE PRIMER AND FINISHED PAINTED BLUE AFTER INSTALLATION. (SEE APPROVED MANUFACTURERS' PRODUCT LIST)
5. BY-PASS PIPE DIAMETER SHALL BE SAME SIZE AS MAIN PIPE.
6. TO SECURE VALVES: CUSTOMER TO SUPPLY GALVANIZED CHAIN, IRCDUS TO SUPPLY LOCK.
7. RPZ'S SHALL BE INSPECTED, CERTIFIED AND REPORTED ON AN ANNUAL BASIS IN ACCORDANCE WITH THE INDIAN RIVER COUNTY CROSS CONNECTION CONTROL PROGRAM REQUIREMENTS.

INDIAN RIVER COUNTY
DEPARTMENT OF
UTILITY SERVICES



MASTER METER
COMBINATION ASSEMBLY
(3" OR LARGER)

MARCH 2018

DRAWING
NO.
W-12