


PLAN VIEW

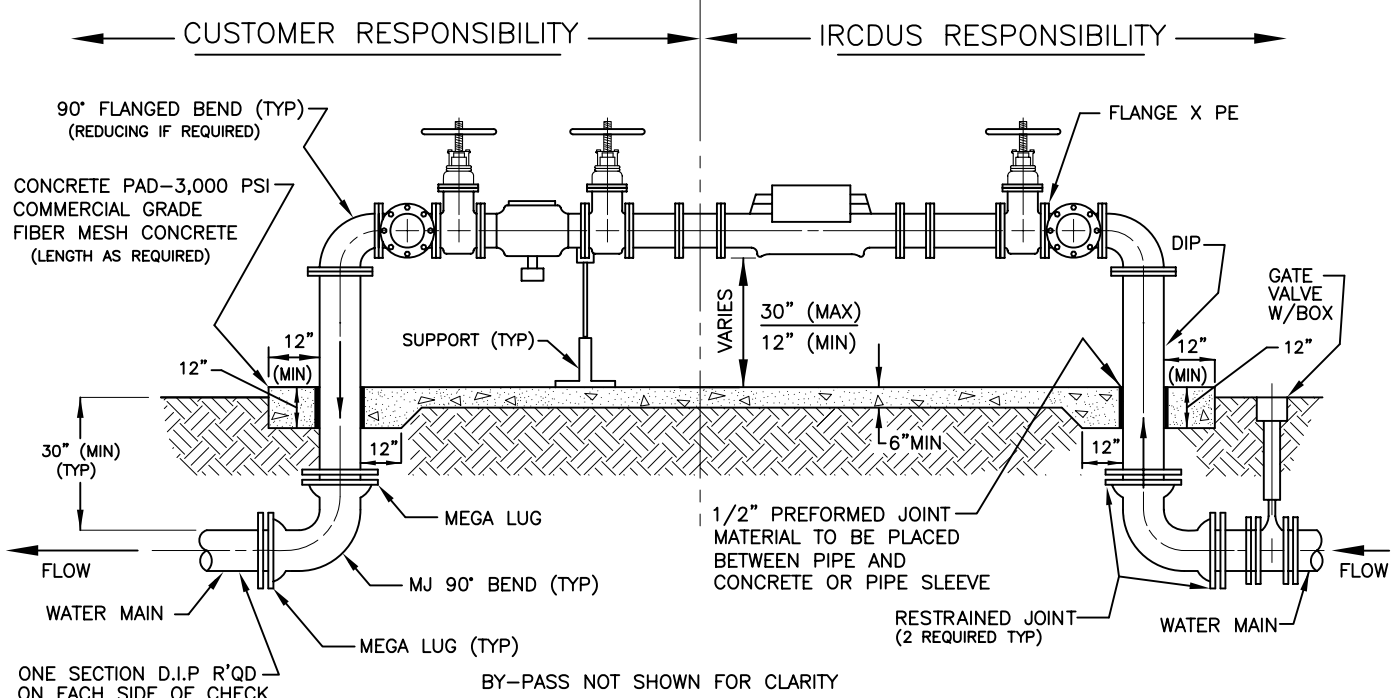

ELEVATION

-ART-

NOTES

1. ALL ABOVE GROUND PIPING SHALL BE FLANGED DUCTILE IRON.
2. FIELD FABRICATED FLANGES MUST BE APPROVED BY IRCDUS ENGINEERING.
3. DEVICE TO BE INSTALLED IN STRICT ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS.
4. ASSEMBLY TO BE PRIMED WITH RUST INHIBITIVE PRIMER AND FINISHED PAINTED AFTER INSTALLATION. (SEE APPROVED MANUFACTURERS' PRODUCT LIST)
5. BY-PASS PIPE DIAMETER SHALL BE SAME SIZE AS MAIN PIPE.
6. TO SECURE VALVES: CUSTOMER TO SUPPLY GALVANIZED CHAIN, IRCDUS TO SUPPLY LOCK.

INDIAN RIVER COUNTY DEPARTMENT OF UTILITIES SERVICES		<h2 style="margin: 0;">MASTER METER COMBINATION ASSEMBLY</h2> <p style="margin: 0;">(3" OR LARGER)</p>	DRAWING NO. <b style="font-size: 1.5em;">W-12
MARCH 2014			