


A CORPORATION STOP SHALL BE INSTALLED WITH A LENGTH OF 1"Ø COPPER TUBING EXTENDING ABOVE THE FINISHED GRADE. THE TUBING SHALL BE INSTALLED WITH A 180° DOWNTURNED BEND.

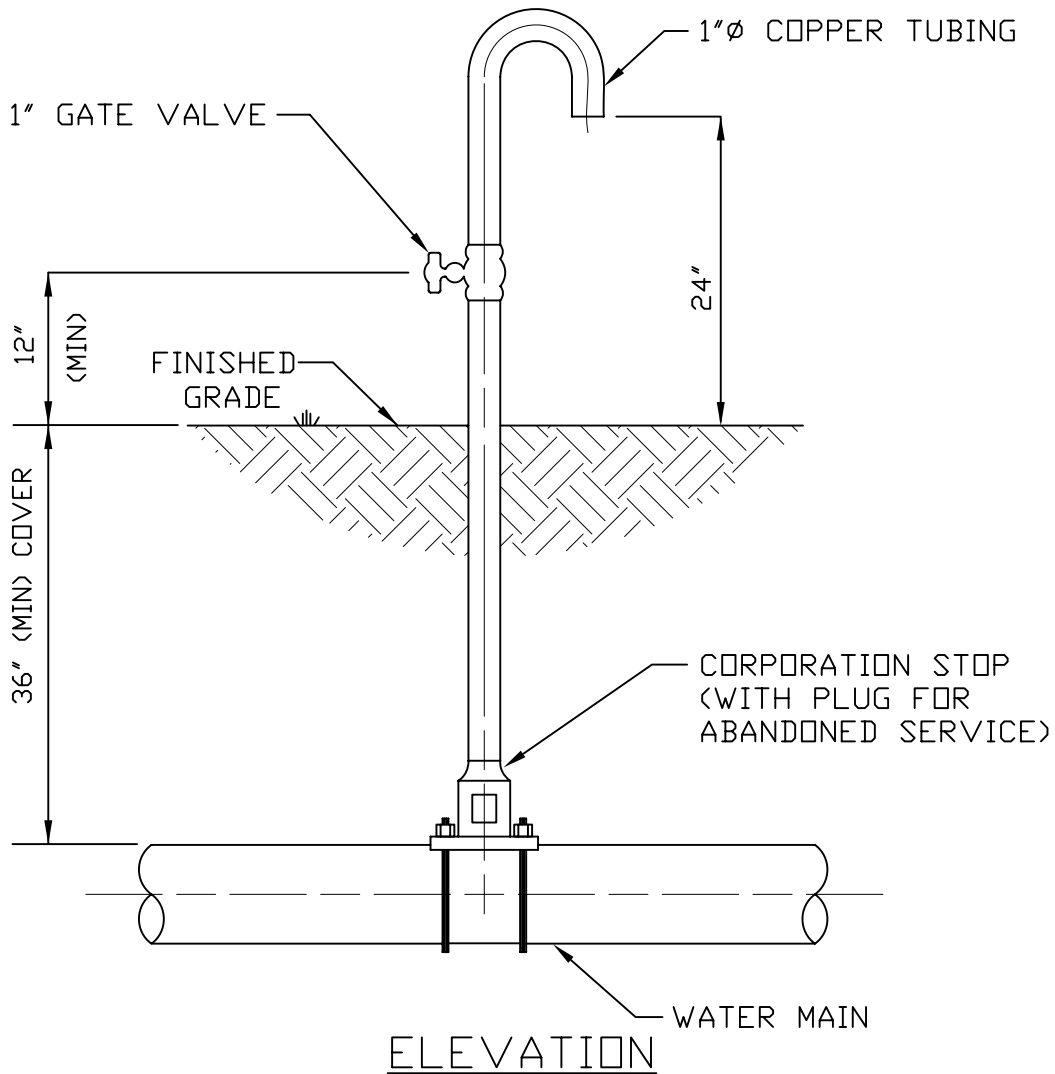

-ART-

NOTES

1. TEMPORARY SAMPLING POINT MAY BE CONSTRUCTED OF ALTERNATE MATERIALS AS APPROVED BY IRCDS.
2. NO SAMPLING POINT SHALL BE CONSTRUCTED AT FIRE HYDRANTS.
3. WHEN SAMPLING IS COMPLETE, SERVICE SHALL BE ABANDONED AND PLUGGED AT MAIN.
4. FIELD INSPECTION BY IRCDS IS REQUIRED BEFORE UTILITIES ARE ACCEPTED.

INDIAN RIVER COUNTY
DEPARTMENT OF
UTILITIES SERVICES



TEMPORARY SAMPLING POINT
(BACTERIOLOGICAL)

DRAWING
NO.

W-8

MARCH 2014